


NOTES:

1. PLACEMENT OF STOP BOX CAN VARY FROM A MAXIMUM OF 5 FEET OUTSIDE THE PROPERTY LINE TO A MAXIMUM OF 5 FEET INSIDE THE PROPERTY LINE. PLACEMENT OF THE STOP BOX OUTSIDE THE PROPERTY LINE IS PREFERRED.
2. OWNER'S RESPONSIBILITY FOR LEAK REPAIR SHALL BE UP TO AND INCLUDING THE TUBE NUT WHICH THREADS ONTO THE CURB STOP. OWNER'S RESPONSIBILITY FOR REPAIRS OTHER THAN LEAK REPAIR EXTENDS TO THE CORPORATION STOP.
3. DENVER WATER WILL REPAIR LEAKS ON SERVICE LINES WHEN NOTIFIED, FROM THE CORPORATION STOP TO CURB STOP.
4. DENVER WATER IS NOT RESPONSIBLE FOR ANY DAMAGE THAT MAY OCCUR DUE TO A LEAK ON A SERVICE LINE. THIS IS THE RESPONSIBILITY OF THE OWNER OF THE PROPERTY TO WHICH THE SERVICE LINE IS CONNECTED.

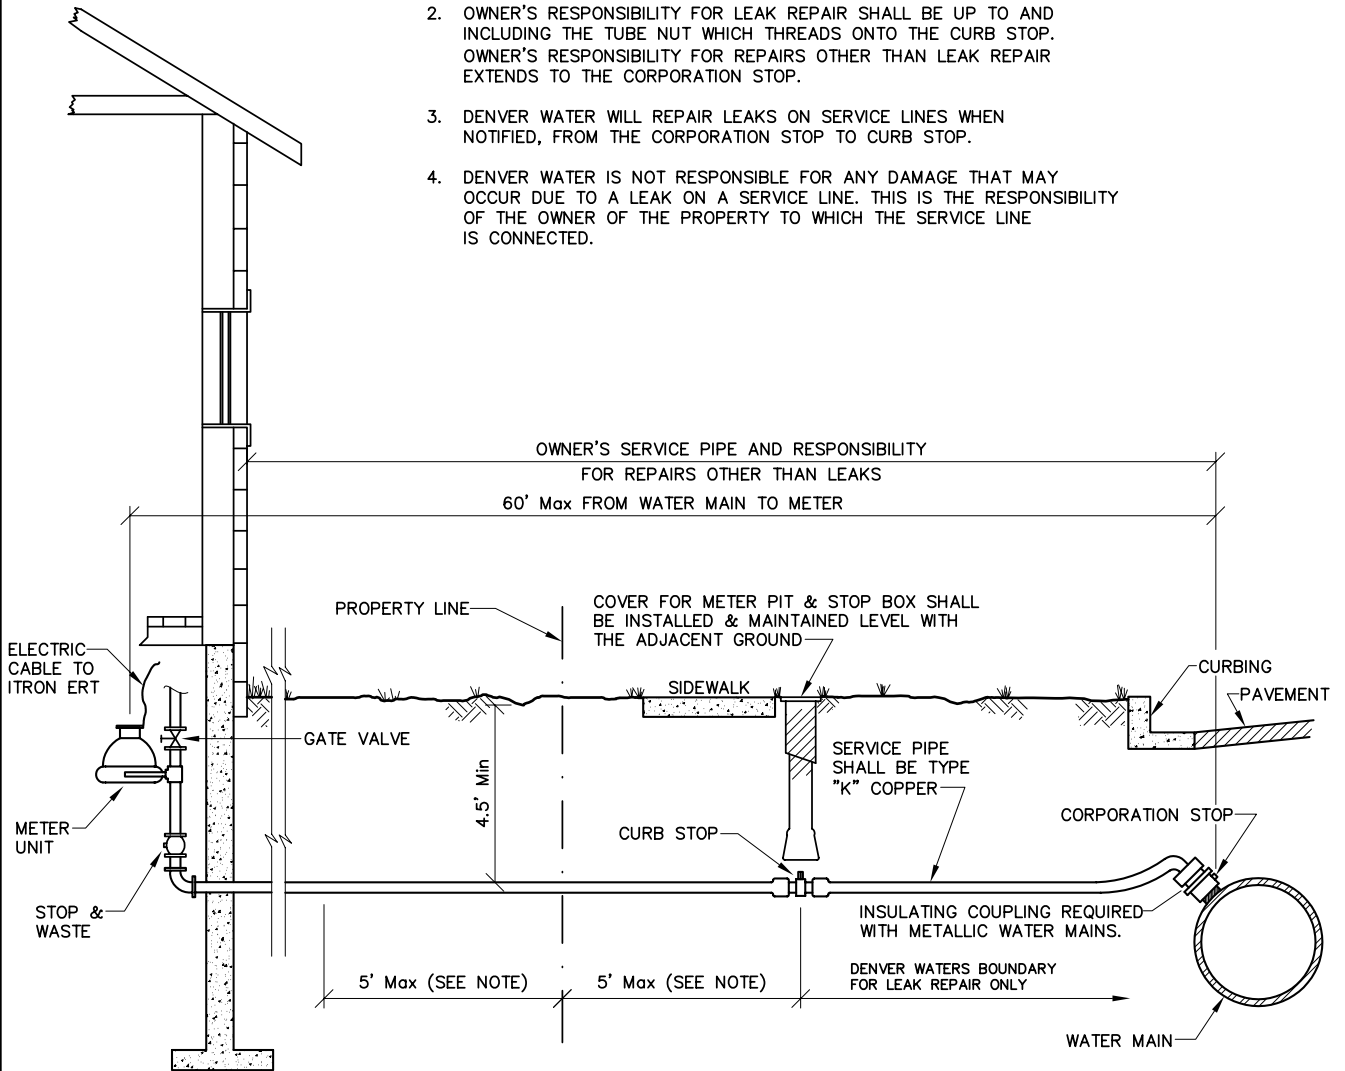

SHOULD ANY SITUATION ARISE OTHER THAN SHOWN CONCERNING THE DEPTH OR OBSTRUCTION OF SERVICE LINE OR THE PLACEMENT OF METER PIT OR STOP BOX CALL FIELD INSPECTOR OR FIELD SUPERVISOR.

DENVER WATER

1600 West 12th Avenue • Denver, Colorado 80204
Phone (303) 628-6000 • Telecopier No. (303) 628-6851

**SERVICE LINE, STOP BOX AND
INSIDE METER INSTALLATION
FOR 3/4" AND 1" METER**

Scale: NONE Date: AUGUST 1995

Drawn: C.B.B. Tr: Ck:

Approved: Dr. 127 No. 35